



- NOTES:
- PLEASE VERIFY VOLTAGE, PHASE & MOUNTING.
 - ALL OPTIONAL ARE AT ADDED COST.
 - A CLEARANCE OF 6" SHOULD BE ALLOWED FOR ACCESS TO ELECTRIC BOX.
 - CONTROL VOLTAGE IS A NEC CLASS 2 CIRCUIT.
 - AVERAGE DOOR TRAVEL SPEED IS 8" PER SECOND.

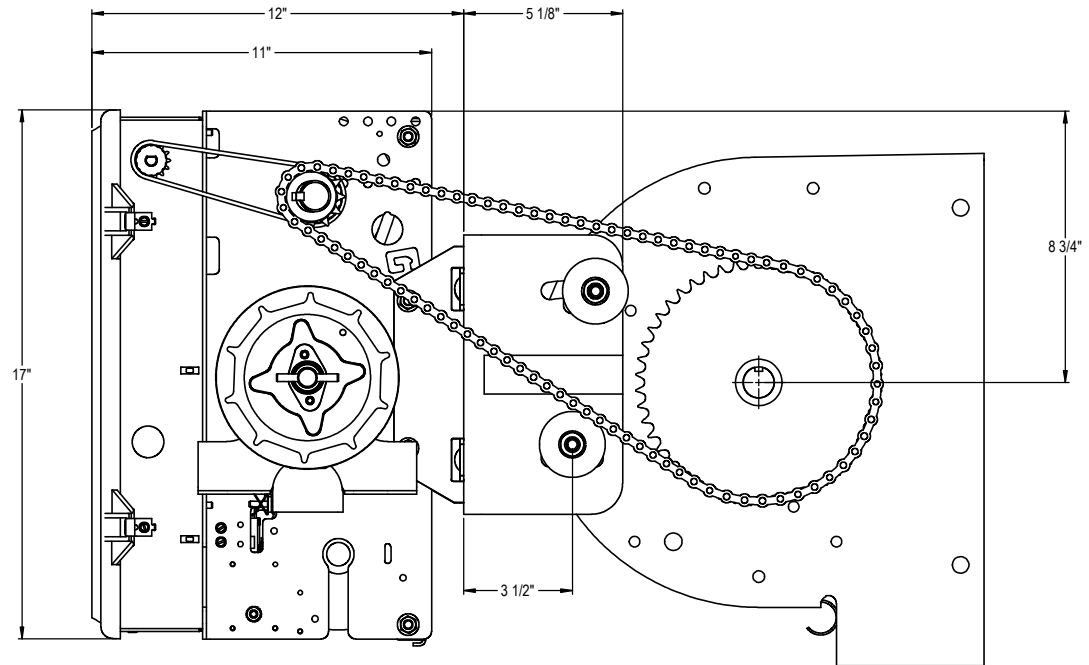

ELECTRIC OPERATOR: GCL-MH (MEDIUM DUTY)	
DOOR TYPE	ROLLING STEEL:
MOUNTING TYPE:	FRONT OF HOOD
PROJECT:	
ARCHITECT:	
CONTRACTOR:	
DISTRIBUTOR:	
PLANT:	
DRAWN BY:	DATE:
APPROVED BY:	DATE:
DWG NO.	SHT ___ OF ___
ENG. CERT. NO.	
112272.0001 REV. -	

ARCHITECT DOOR NUMBER	QTY	FACTORY ORDER NUMBER	MOUNT TYPE		VOLTS		PHASE	CONTROL STATION		
			FRONT OF HOOD	ROLLING STEEL	115	230		3 BTN	KEY SWITCH	EXT. FLUSH 3 BUTTON

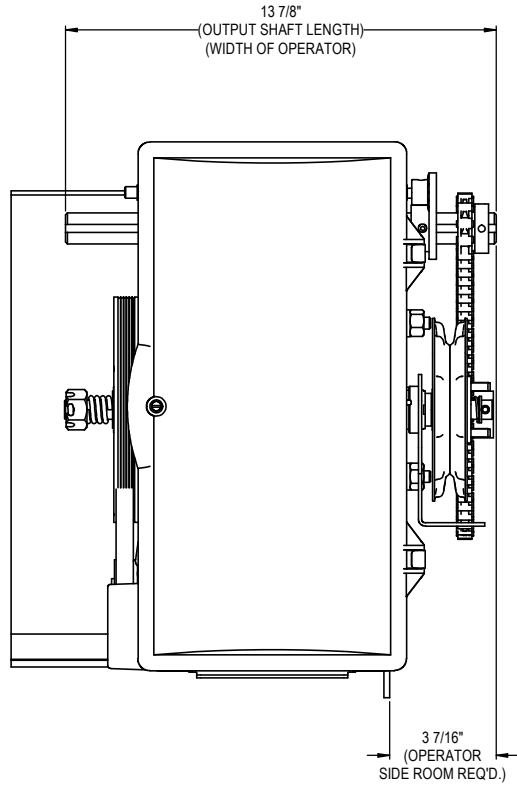