


▷ NOTES:

1. PLEASE VERIFY VOLTAGE, PHASE & MOUNTING.
2. ALL OPTIONS ARE AT ADDED COST.
3. A CLEARANCE OF 6" SHOULD BE ALLOWED FOR ACCESS TO ELECTRIC BOX.
4. CONTROL VOLTAGE IS A NEC CLASS 2 CIRCUIT.
5. AVERAGE DOOR TRAVEL SPEED IS 11" PER SECOND.

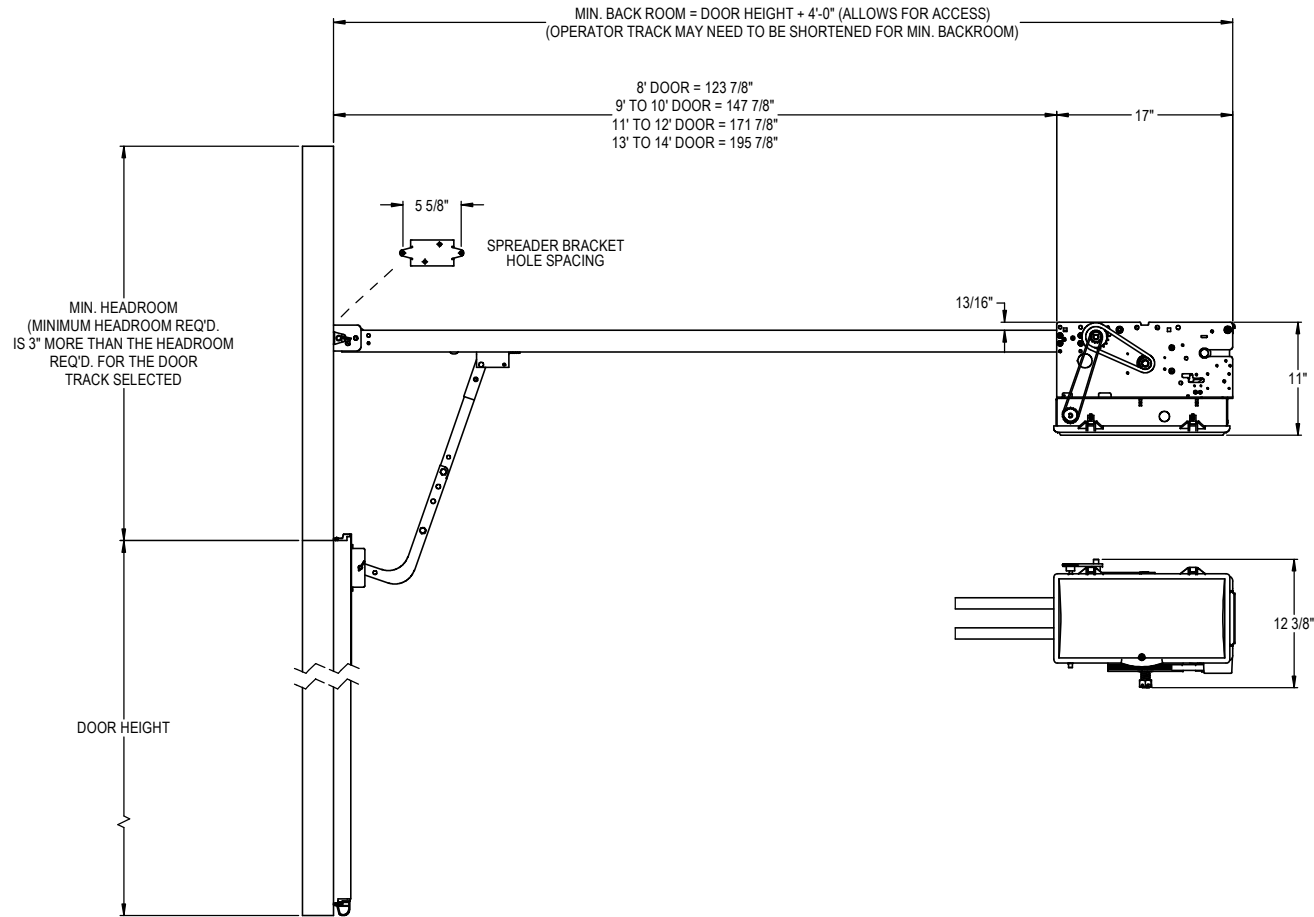

ELECTRIC OPERATOR: GCL-MT (MEDIUM DUTY)	
DOOR TYPE:	SECTIONAL
MOUNTING TYPE:	TROLLEY (SIDE VIEW)
PROJECT:	
ARCHITECT:	
CONTRACTOR:	
DISTRIBUTOR:	
PLANT:	
DRAWN BY:	DATE:
APPROVED BY:	DATE:
DWG NO.	SHT ___ OF ___
ENG. CERT. NO.	
<b>112281.0001 REV.-</b>	

ARCHITECT DOOR NUMBER	QTY	FACTORY ORDER NUMBER	CONTROL STATION						
			MOUNT TYPE	VOLTS		PHASE	CONTROL STATION		
			TROLLEY	115	230	1 PHASE	3 BTN	KEY SWITCH	EXT. FLUSH 3 BUTTON

