


- NOTES:  
 1. WIRE SIZE TO BE DETERMINED BY A LICENSED ELECTRICIAN.

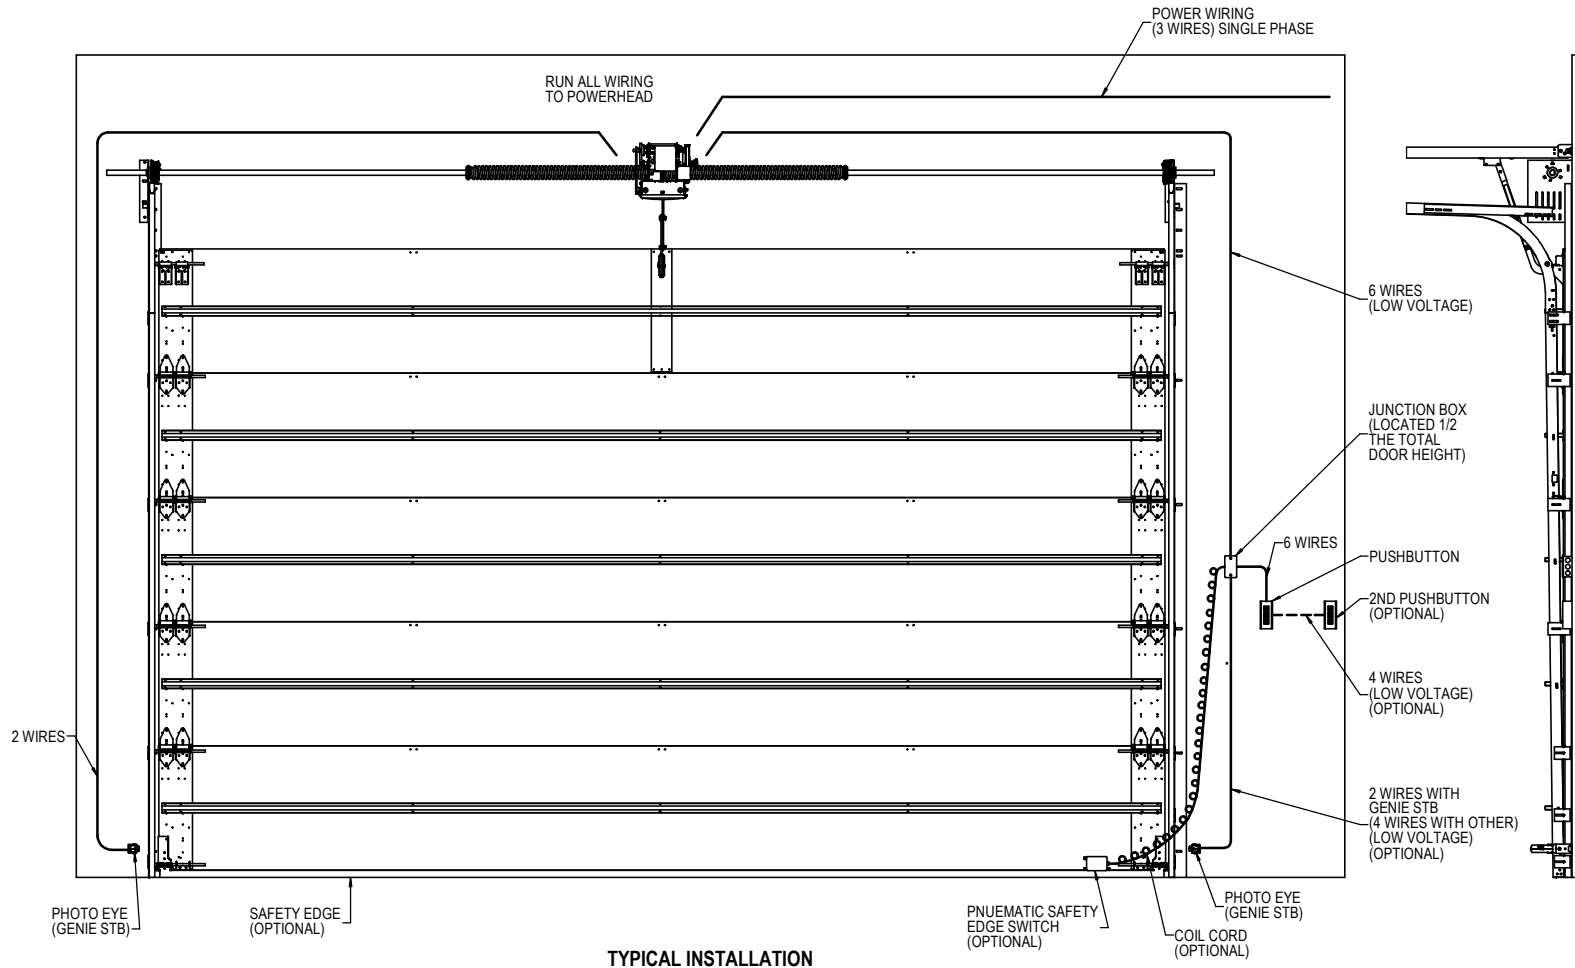

TYPICAL INSTALLATION

ELECTRIC OPERATOR: GCL-MT (MEDIUM DUTY)	
DOOR TYPE:	SECTIONAL
MOUNTING TYPE:	TROLLEY (DOOR & OPERATOR LAYOUT)
PROJECT:	
ARCHITECT:	
CONTRACTOR:	
DISTRIBUTOR:	
PLANT:	
DRAWN BY:	DATE:
APPROVED BY:	DATE:
DWG NO.	SHT ___ OF ___
ENG. CERT. NO.	
<b>112282.0001 REV.-</b>	

ARCHITECT DOOR NUMBER	QTY	FACTORY ORDER NUMBER	MOUNT TYPE						CONTROL STATION		
			TROLLEY	115	230	1 PHASE	3 BTN	KEY SWITCH	EXT. FLUSH 3 BUTTON		

