


NOTES:
 1. WIRE SIZE TO BE DETERMINED BY A LICENSED ELECTRICIAN.

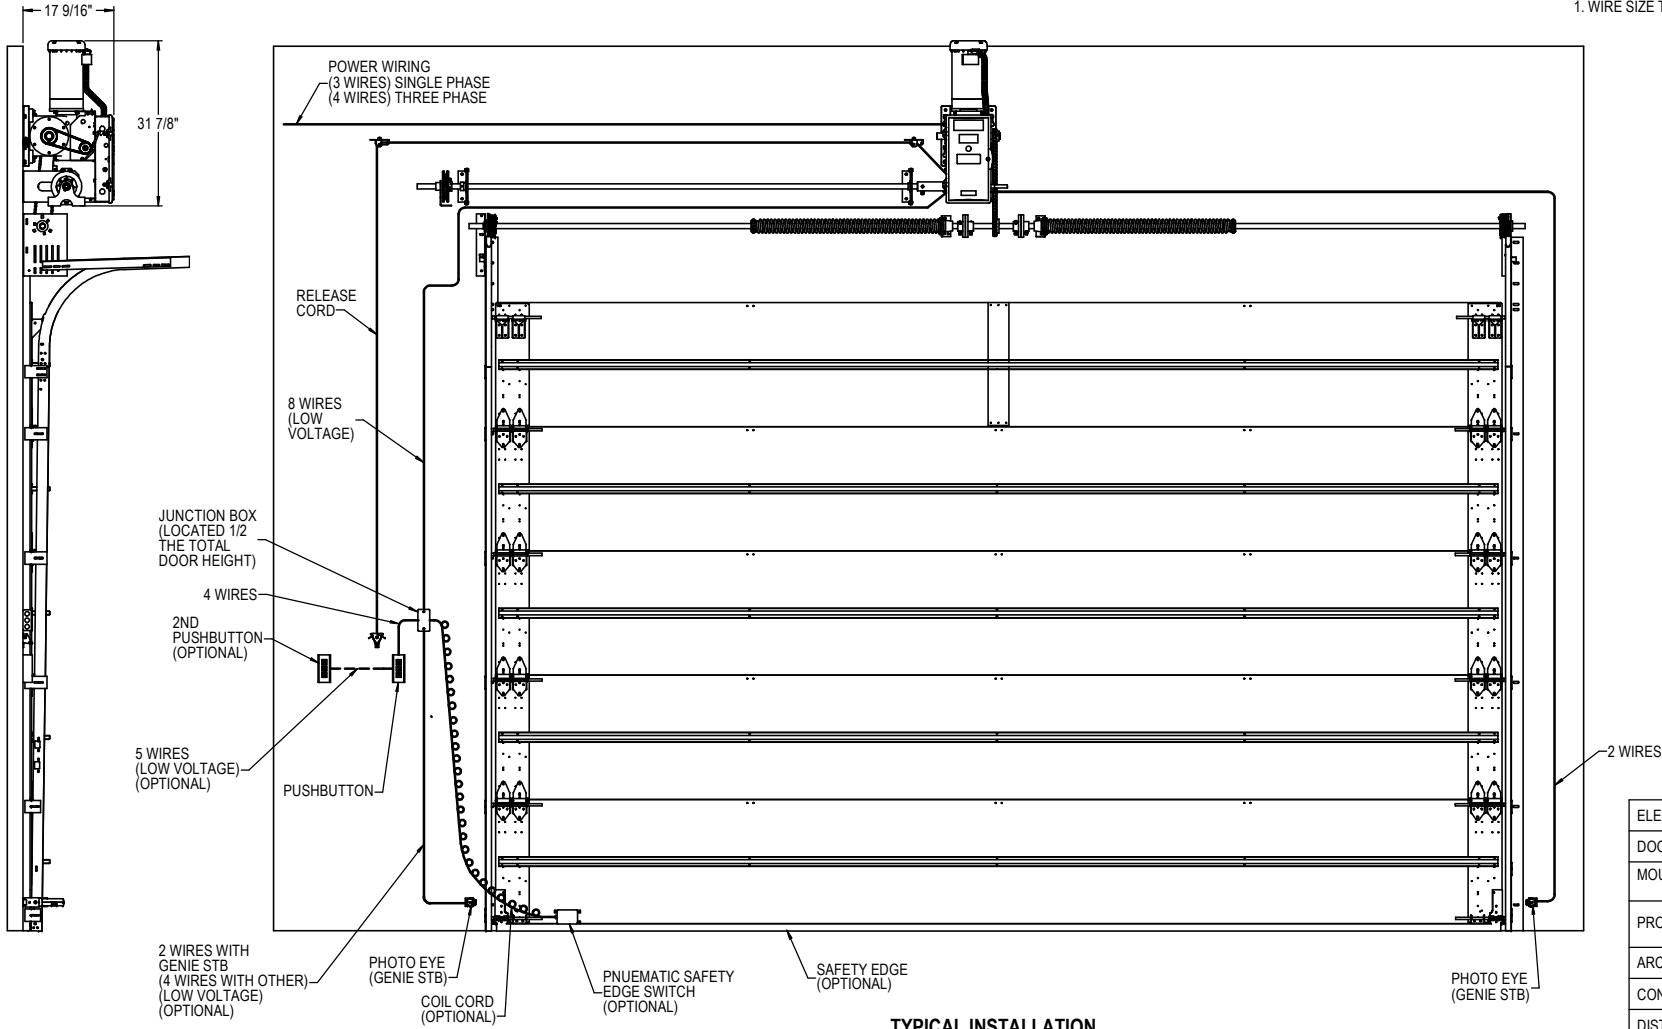

TYPICAL INSTALLATION

| | |
|--|----------------------------------|
| ELECTRIC OPERATOR: GCL-GH (HEAVY DUTY) (3HP) | |
| DOOR TYPE: | SECTIONAL |
| MOUNTING TYPE: | CENTERMOUNT (DOOR & OPER LAYOUT) |
| PROJECT: | |
| ARCHITECT: | |
| CONTRACTOR: | |
| DISTRIBUTOR: | |
| PLANT: | |
| DRAWN BY: | DATE: |
| APPROVED BY: | DATE: |
| DWG NO. | SHT ___ OF ___ |
| ENG. CERT. NO. | |
| 112302.0001 REV.- | |

| ARCHITECT DOOR NUMBER | QTY | FACTORY ORDER NUMBER | MOUNT TYPE | VOLTS | | | | | PHASE | | CONTROL STATION | | | |
|-----------------------|-----|----------------------|------------|-------------|-----|-----|-----|-----|-------|---------|-----------------|-------|------------|---------------------|
| | | | | CENTERMOUNT | 115 | 208 | 230 | 460 | 575 | 1 PHASE | 3 PHASE | 3 BTN | KEY SWITCH | EXT. FLUSH 3 BUTTON |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |

