


NOTES:
 1. WIRE SIZE TO BE DETERMINED BY A LICENSED ELECTRICIAN.

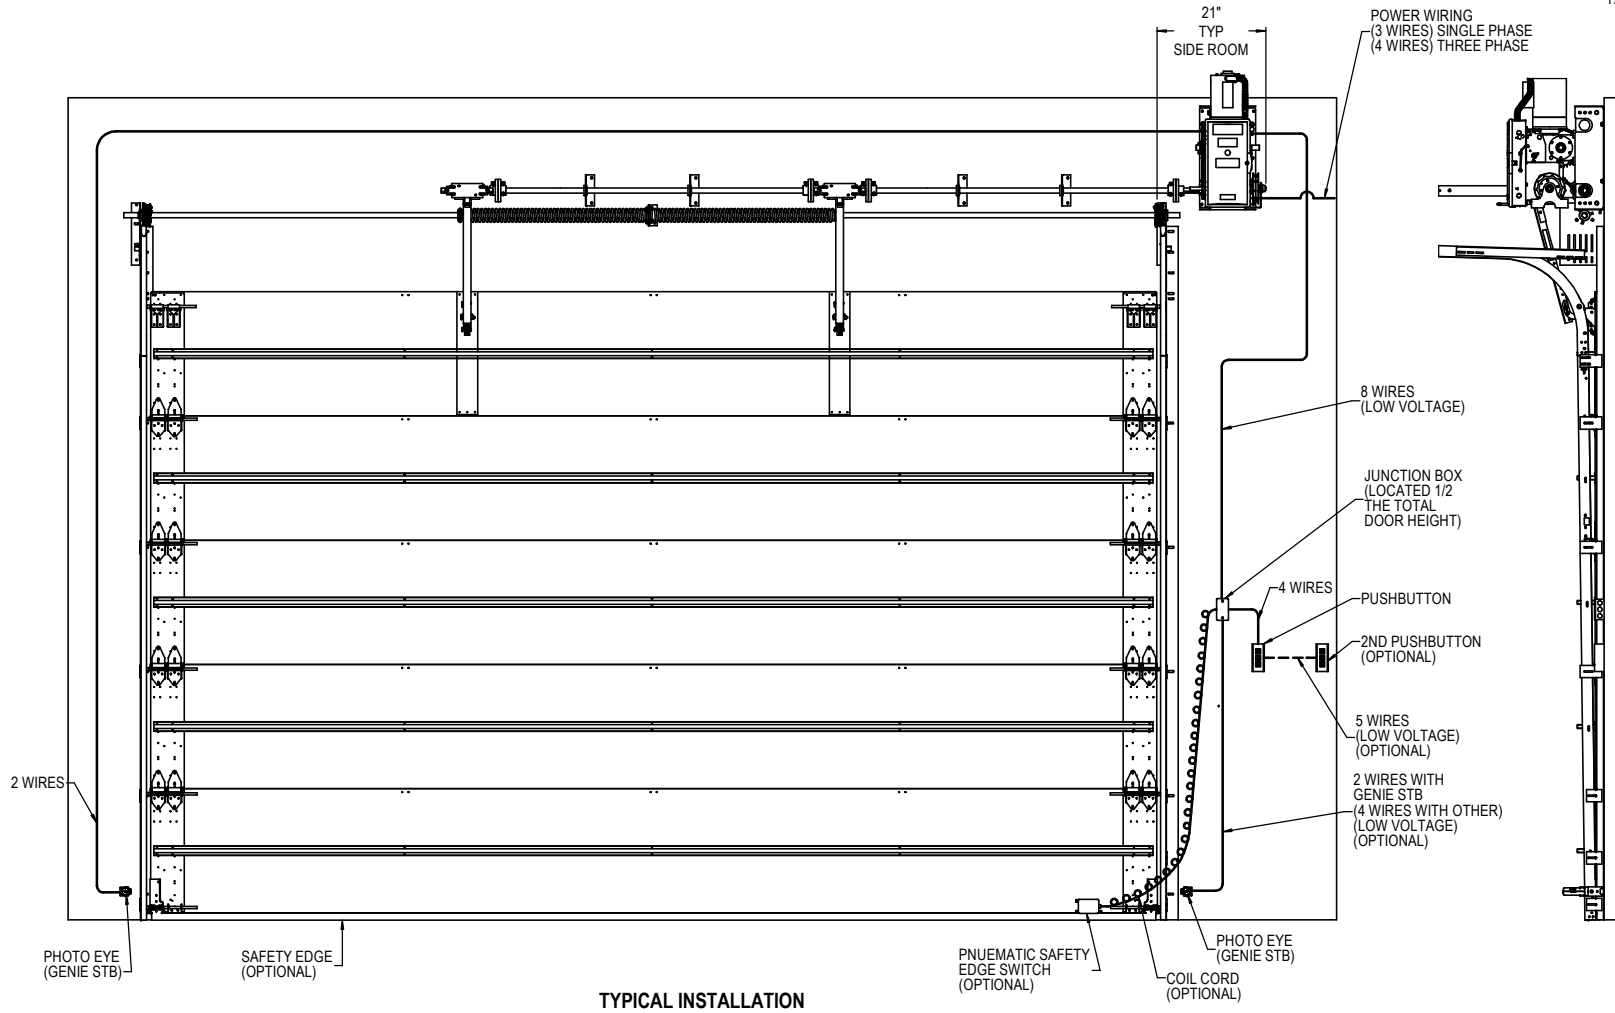

TYPICAL INSTALLATION

ELECTRIC OPERATOR: GCL-GHT (HEAVY DUTY) (1/2, 3/4, 1 HP)	
DOOR TYPE:	SECTIONAL
MOUNTING TYPE:	SIDEMOUNT DUAL TROLLEY (DOOR & OPER)
PROJECT:	
ARCHITECT:	
CONTRACTOR:	
DISTRIBUTOR:	
PLANT:	
DRAWN BY:	DATE:
APPROVED BY:	DATE:
DWG NO.	SHT ___ OF ___
ENG. CERT. NO.	
112303.0001 REV.-	

ARCHITECT DOOR NUMBER	QTY	FACTORY ORDER NUMBER	MOUNT TYPE	VOLTS					PHASE		CONTROL STATION			
			SIDEMOUNT DUAL TROLLEY	115	208	230	460	575	1 PHASE	3 PHASE	3 BTN	KEY SWITCH	EXT. FLUSH 3 BUTTON	

