


▷ NOTES:

1. PLEASE VERIFY VOLTAGE, PHASE & MOUNTING.
2. ALL OPTIONS ARE AT ADDED COST.
3. A CLEARANCE OF 6" SHOULD BE ALLOWED FOR ACCESS TO ELECTRIC BOX.
4. CONTROL VOLTAGE IS A NEC CLASS 2 CIRCUIT.
5. AVERAGE DOOR TRAVEL SPEED IS 11" PER SECOND.

- 8' DOOR = 135 3/8"
- 10' DOOR = 159 3/8"
- 12' DOOR = 183 3/8"
- 14' DOOR = 207 3/8"
- 16' DOOR = 231 3/8"
- 18' DOOR = 255 3/8"
- 20' DOOR = 279 3/8"
- 24' DOOR = 327 3/8"

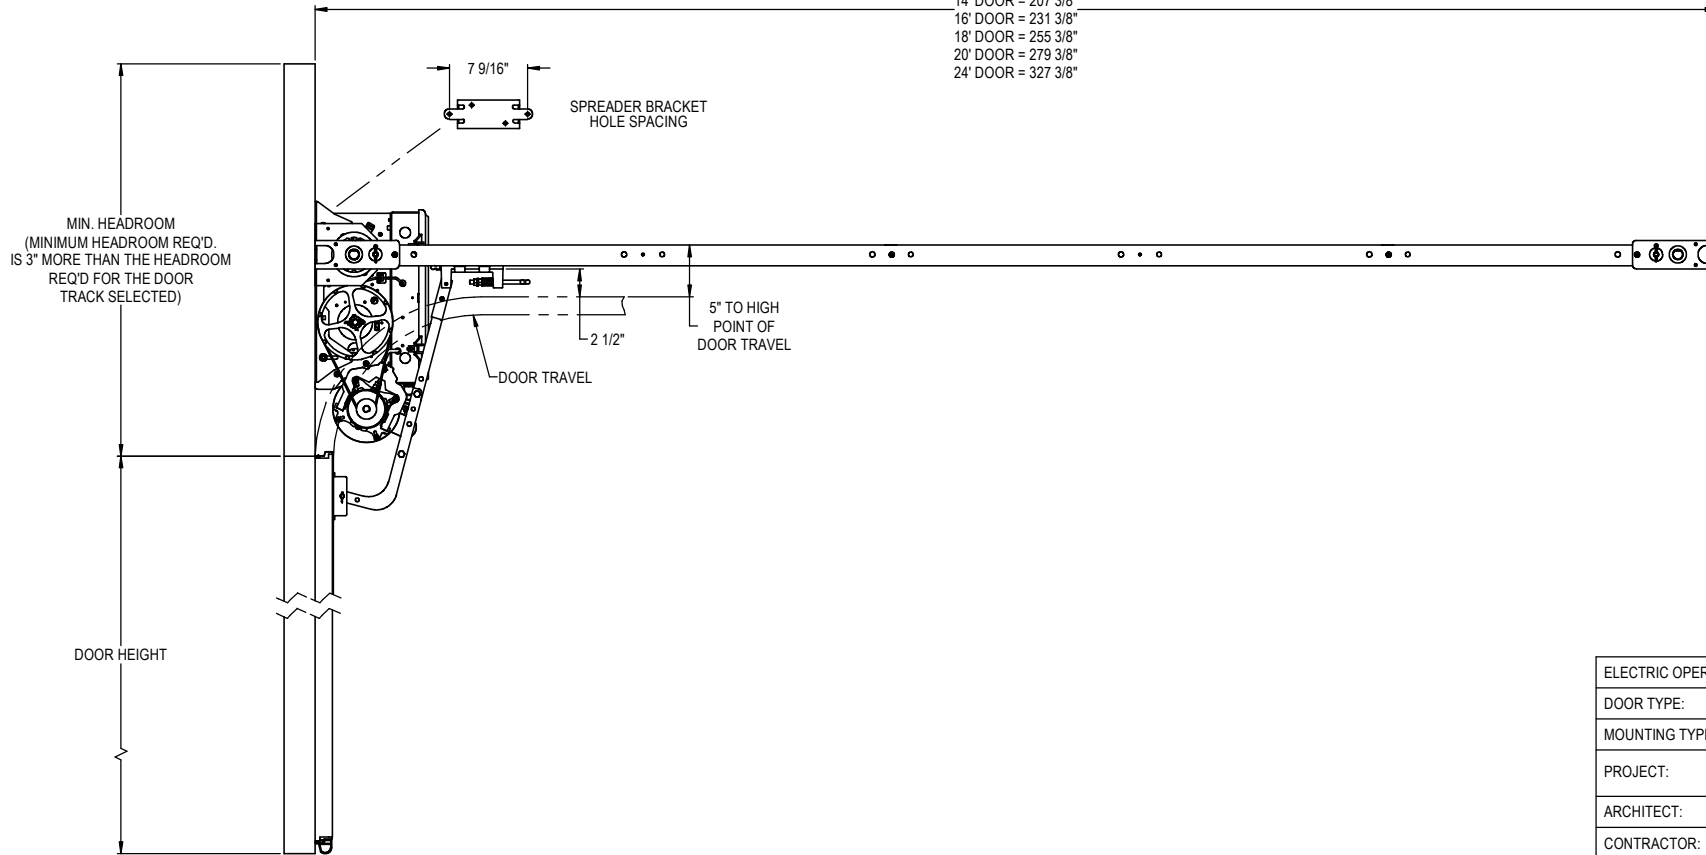

ELECTRIC OPERATOR: GCL-HT (STANDARD DUTY)	
DOOR TYPE:	SECTIONAL
MOUNTING TYPE:	SIDEMOUNT TROLLEY SIDE VIEW
PROJECT:	
ARCHITECT:	
CONTRACTOR:	
DISTRIBUTOR:	
PLANT:	
DRAWN BY:	DATE:
APPROVED BY:	DATE:
DWG NO.	SHT ___ OF ___
ENG. CERT. NO.	
112305.0001 REV.-	

ARCHITECT DOOR NUMBER	QTY	FACTORY ORDER NUMBER	MOUNT TYPE	VOLTS					PHASE		CONTROL STATION			
				SIDEMOUNT TROLLEY	115	208	230	460	575	1 PHASE	3 PHASE	3 BTN	KEY SWITCH	EXT. FLUSH 3 BUTTON

