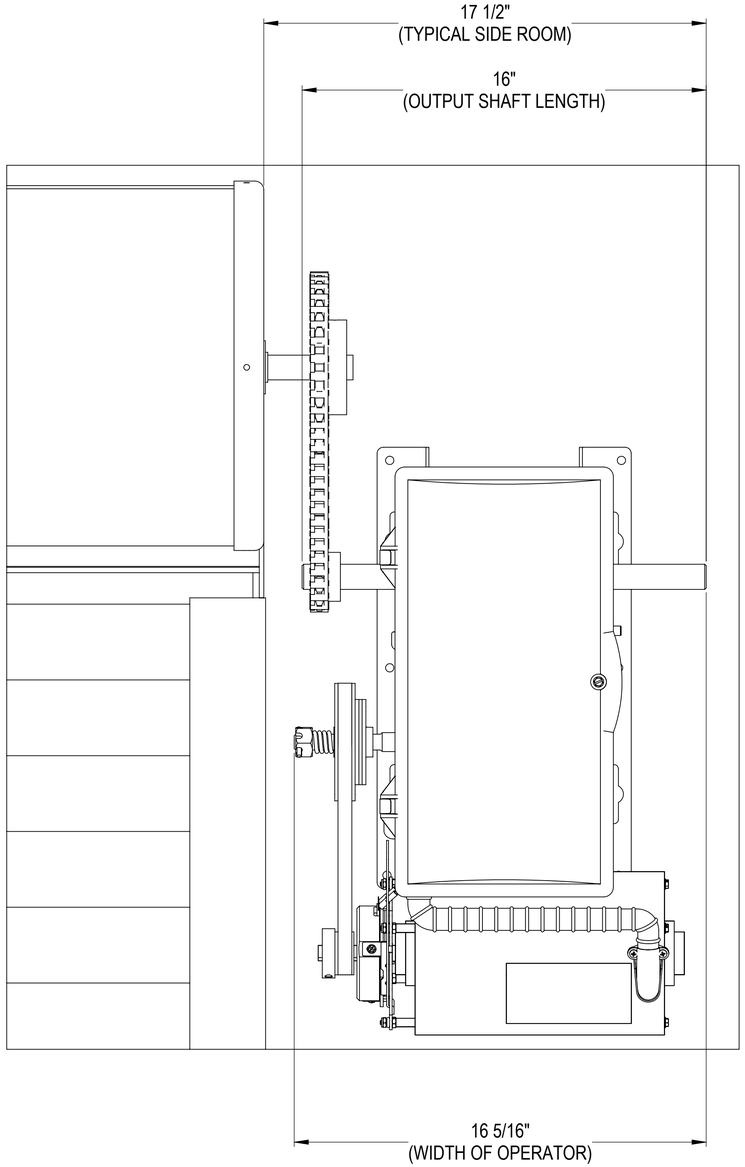

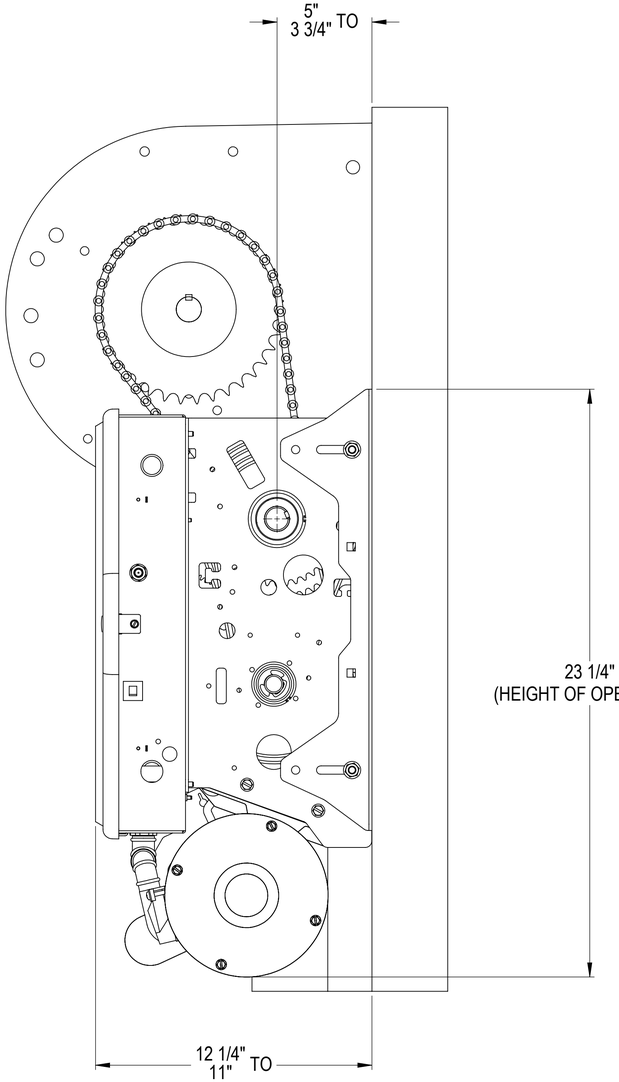

NOTES:

1. PLEASE VERIFY VOLTAGE, PHASE & MOUNTING.
2. ALL OPTIONAL ARE AT ADDED COST.
3. A CLEARANCE OF 6" SHOULD BE ALLOWED FOR ACCESS TO ELECTRIC BOX.
4. CONTROL VOLTAGE IS A NEC CLASS 2 CIRCUIT.
5. AVERAGE DOOR TRAVEL SPEED IS 8" PER SECOND.

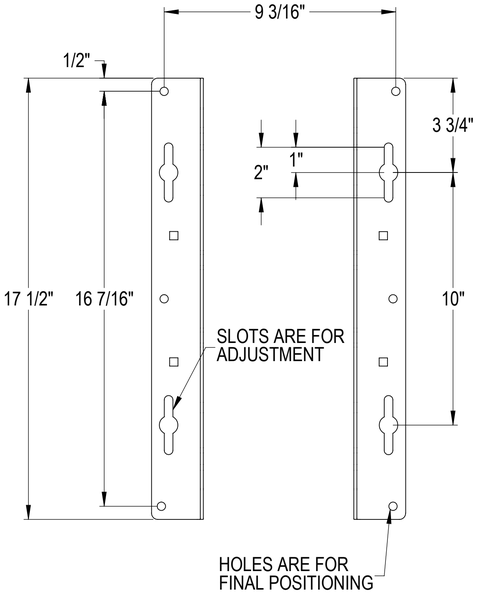

MOUNTING BRACKETS

ELECTRIC OPERATOR: GCL-J (STANDARD DUTY)			
DOOR TYPE:	ROLLING STEEL		
MOUNTING TYPE:	WALL MOUNT		
PROJECT:			
ARCHITECT:			
CONTRACTOR:			
DISTRIBUTOR:			
PLANT:			
DRAWN BY:		DATE:	
APPROVED BY:		DATE:	
DWG NO.		SHT ___ OF ___	
ENG. CERT. NO.			
112383.0001 REV. -		GENIE	

ARCHITECT DOOR NUMBER	QTY	FACTORY ORDER NUMBER	MOUNT TYPE	VOLTS					PHASE		CONTROL STATION		
			WALL MOUNT ROLLING STEEL	115	208	230	460	575	1 PHASE	3 PHASE	3 BTN	KEY SWITCH	EXT. FLUSH 3 BUTTON